


<p style="text-align: center;">DATED on the</p> <p style="text-align: center;">5th day of March, 2010.</p>	 ALBERTA UTILITIES COMMISSION
Appendix 4 to Decision 2010-095 ATCO Electric Ltd. Transmission line 7L129	Application No. 1605280

ATCO Electric Ltd. (the Operator), pursuant to Permit and Licence No. AP 79-53, is the Operator of the 144-kV transmission line 7L50 (Transmission Line) from Battle River 757S substation to Vermilion 710S substation in the Battle River – Vermilion area.


The Operator, by Application No. 1605280, registered on July 20, 2009 (the Application), applied to the Alberta Utilities Commission (the Commission) for approval to alter (Alteration) and operate the Transmission Line by terminating the Transmission line at the Buffalo Creek 526S substation and re-designating the portion between the Buffalo Creek 526S substation and the Vermilion 710S substation as Transmission Line 7L129.

The Commission, pursuant to sections 14 and 15 of the *Hydro and Electric Energy Act*, approved the Application in Decision 2010-095 and granted to the Operator a Permit to alter and a Licence to operate the Transmission Line subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act* (the Acts), any Regulations made under the Acts, any Orders made under the Acts, the Commission Rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. The route of the Transmission Line shall be as shown on Appendix A and as described in the Application;
2. Where, in the Commission’s opinion, it is in the public interest to do so, the Commission may direct the alteration or relocation of any part of the Transmission Line pursuant to sections 17 and 19 of the *Hydro and Electric Energy Act*;
3. Specifications of the Transmission Line shall include the following:
 - (a) the Transmission Line shall be designed, built for, and operated at a nominal voltage of 144-kV;
 - (b) the structures shall be constructed of materials as specified in the Application and other previous approvals pertaining to the Transmission Line; and
 - (c) other aspects of the alteration as more particularly described in the Application and other previous approvals pertaining to the Transmission Line.

4. The Operator shall file with the Commission, within 30 days of completing the Transmission Line Alteration, the Energization Certificate for the Transmission Line issued by the Alberta Electric System Operator and by the Operator respectively to confirm that the Transmission Line Alteration has been completed and the Transmission Line is being operated in accordance with the provisions of this Permit and Licence;
5. Unless otherwise authorized by the Commission, the Transmission Line Alteration shall be completed by December 31, 2010;
6. The Commission may cancel or suspend this Permit and Licence, in whole or in part, in accordance with section 41 of the *Hydro and Electric Energy Act* or may review this Permit and Licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with section 10 of the *Alberta Utilities Commission Act*; and
7. Permit and Licence No. AP 79-53 is rescinded.

END OF DOCUMENT

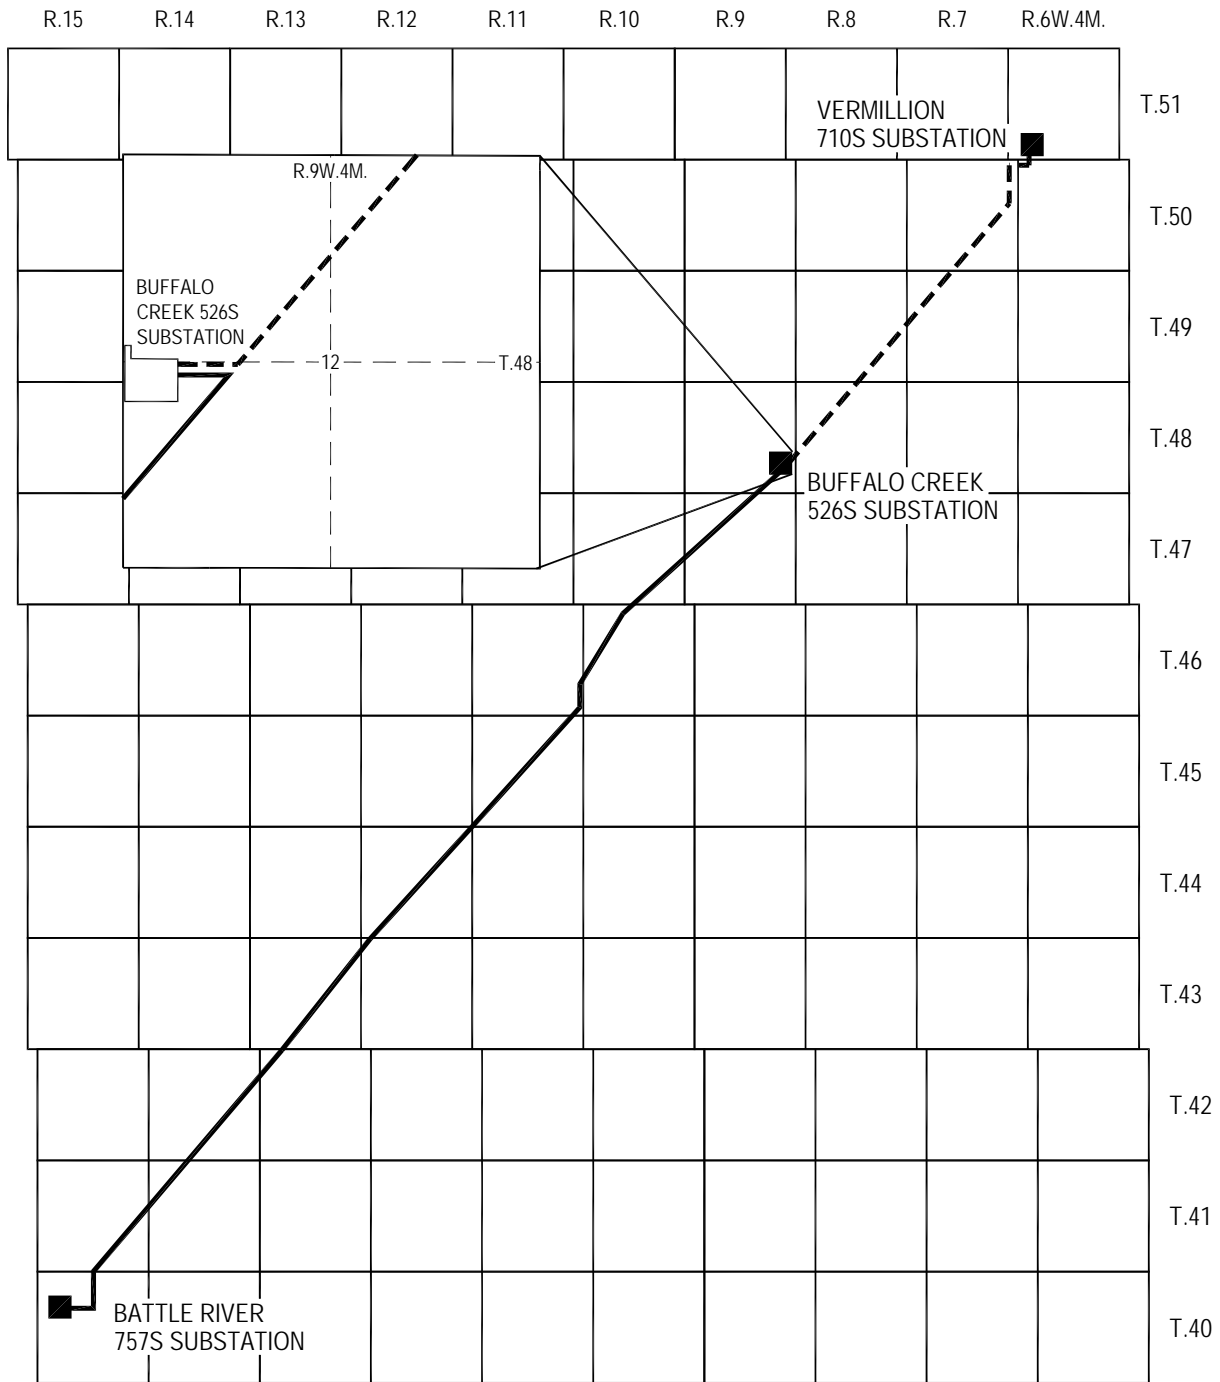

BATTLE RIVER TO VERMILLION



APPENDIX A TO APPROVAL NO. U2010-102

PREVIOUS APPROVAL NO. AP79-53

LEGEND

- 144-kV TRANSMISSION LINE 7L50
- - 144-kV TRANSMISSION LINE 7L129