


<p style="text-align: center;">DATED on the</p> <p style="text-align: center;">18th day of March, 2010.</p>	 ALBERTA UTILITIES COMMISSION
<p>Appendix 1 to Decision 2010-122</p> <p>AltaLink Management Ltd. Time Extension for New Transmission Line 696L</p>	<p>Proceeding I.D. 529 Application No. 1605963</p>

AltaLink Management Ltd. (Operator) by Application No. 1605921, registered on March 25, 2009, applied to the Alberta Utilities Commission (the Commission) for approval to construct and operate 144-kV transmission line 696L (Transmission Line). The Commission, pursuant to section 14 of the *Hydro and Electric Energy Act*, approved Application No. 1605921 and granted Permit and Licence U2009-296 for that purpose.


Clause 5 of Permit and Licence No. U2009-296 provided that the Transmission Line was to be completed by March 31, 2010. Clause 5 also provided that upon application by the Operator, the Commission may stipulate a later date for completing the Transmission Line. By Application No. 1605963 registered on March 5, 2010 (the Application), the Operator requested a stipulation for an extension of time to complete construction of the Transmission Line.

The Commission, pursuant to section 19 of the *Hydro and Electric Energy Act*, approved the Application in Decision 2010-122, and pursuant to section 14 and 15 of the *Hydro and Electric Energy Act* granted the Operator a Permit to construct and a Licence to operate the Transmission Line, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act* (the Acts), any Regulations made under the Acts, any Orders made under the Acts, the Commission Rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. Specifications of the Transmission Line shall include the following:
  - (a) the route of the Transmission Line shall be shown on Appendix A;
  - (b) the Transmission Line shall be operated at a nominal voltage of 144-kV; and
  - (c) other aspects of the Transmission Line as more particularly described in Application No. 1605921;
  
2. The Operator shall file with the Commission, within 30 days of completing the Transmission Line, the Energization Certificates for the Transmission Line issued by the Alberta Electric System Operator and by the Operator respectively to confirm that the Transmission Line has been completed and is being operated in accordance with the provisions of this Permit and Licence;

3. Unless otherwise authorized by the Commission, the Transmission Line shall be completed by July 31, 2010;
4. The Commission may cancel or suspend this Licence, in whole or in part, in accordance with section 41 of the *Hydro and Electric Energy Act* or may review this Licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with section 10 of the *Alberta Utilities Commission Act*; and
5. Permit and Licence No. U2009-296 is rescinded.

END OF DOCUMENT

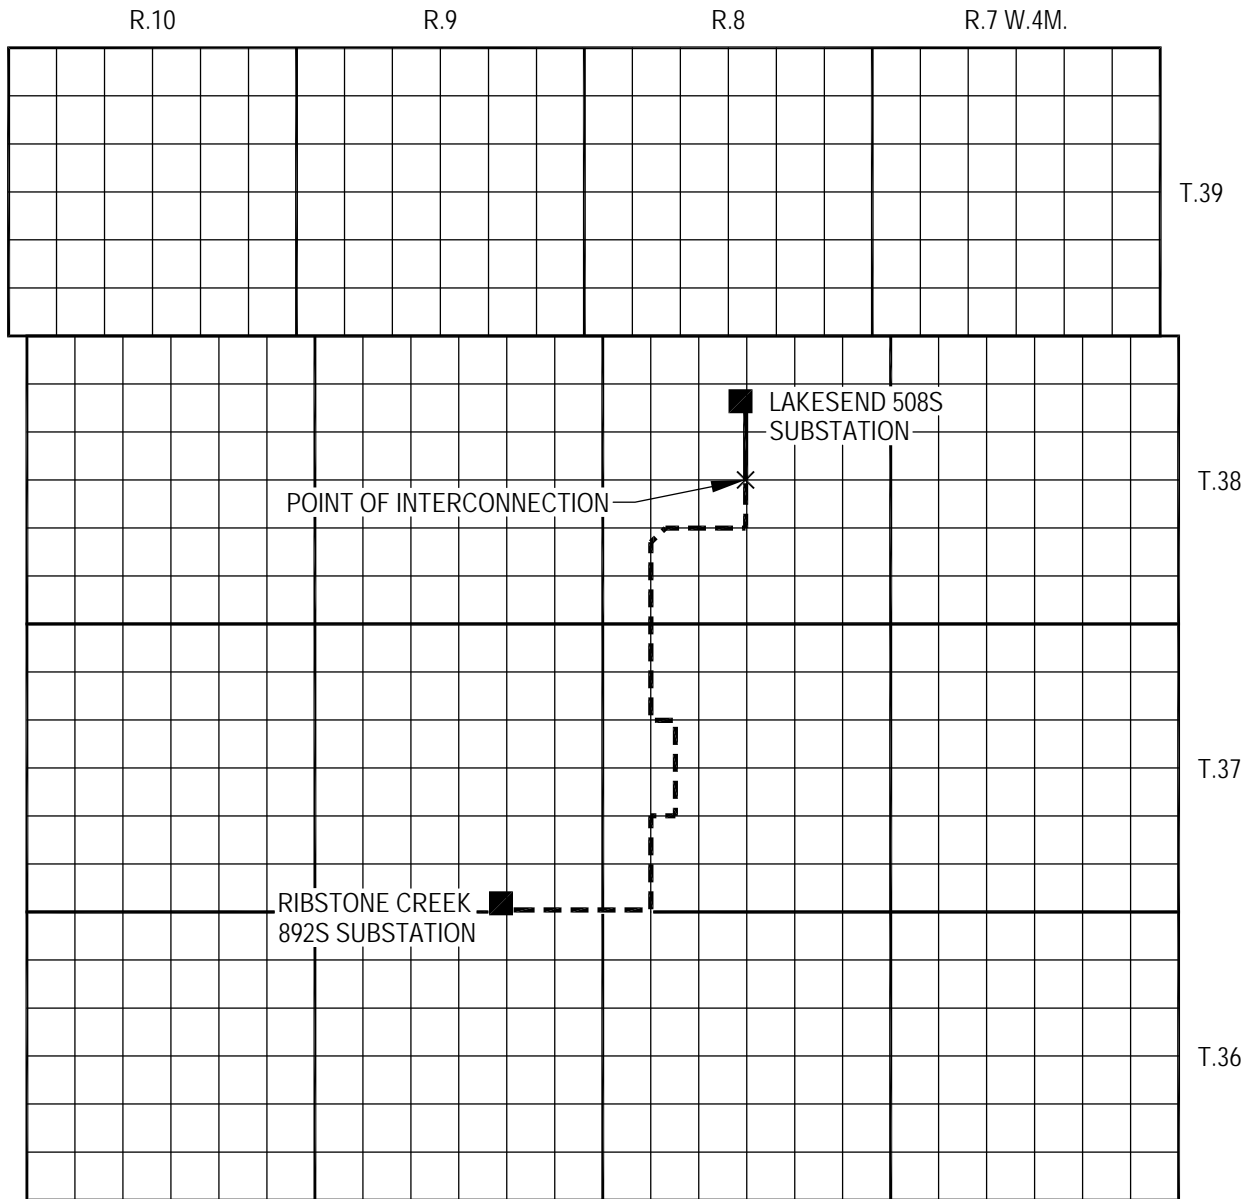



## CZAR - VENTERAN AREA



APPENDIX A PERMIT AND LICENCE NO. U2010-124

### LEGEND

-  ALTALINK MANAGEMENT LTD. 144-KV TRANSMISSION LINE 696L
-  ATCO ELECTRIC LTD. TRANSMISSION LINE 7L696