


Dated on the 27th day of January, 2012	 The Alberta Utilities Commission
---	--


On November 10, 2011, the Alberta Utilities Commission (AUC or the Commission) issued Decision [2011-445](#),¹ with Appendix 6 – Licence No. U2011-399 to AltaLink Management Ltd.

In Appendix 6 to Decision 2011-445, the map incorrectly shows the existing transmission line 953L located east-west along a section line; it should be located east-west along the quarter line one-half mile north. As well, Cordel 755S substation and ATCO's 9L953 were also represented one-half mile south of the proper location and require a one-half mile shift north to show the correct substation location and tap point. Section 48 of AUC Rule 001: *Rules of Practice*, indicates that “[t]he Commission may correct typographical errors, errors of calculation and similar errors made in any of its orders, decisions or directions.”

Appendix 6 to Decision 2011-445 has been amended to correct these mapping errors. The updated Licence No. U2011-399 is attached to this errata document.

END OF DOCUMENT

¹ Decision 2011-445: AltaLink Management Ltd. New 240/138-kV Nilrem 574S Substation, Double-circuit 240-kV Transmission Lines 953L/1047L, and Double-circuit 138-kV Transmission Lines 679L/680L, Application No. 1606753, Proceeding ID No. 938, November 10, 2011.

<p>Dated on the</p> <p>10th day of November, 2011</p>	 <p>The Alberta Utilities Commission</p>
<p>Appendix 6 to Decision 2011-445</p> <p>ATCO Electric Ltd. Transmission Line 9L953</p>	<p>Application No. 1606753 Proceeding ID No. 938</p>

ATCO Electric Ltd. (ATCO), pursuant to Permit and Licence No. [U2005-468](#)¹ is the operator of the 240-kilovolt (kV) transmission line 9L953 from Cordel substation 755S substation to a connection point with AltaLink Management Ltd.’s 240-kV transmission line 953L in the Cordel – Metiskow area.

AltaLink, by Application No. 1606753 registered November 15, 2010, applied to the Alberta Utilities Commission (AUC or the Commission) for approval to alter and operate transmission line 953L. The alteration to transmission line 953L makes the map included in Permit and Licence No. U2005-468 incorrect.

The Commission, pursuant to sections 14, 15 and 19 of the *Hydro and Electric Energy Act*, approved the application in Decision 2011-445² and granted AltaLink a licence to operate the transmission line, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act*, any regulations made under the acts, any orders made under the acts, the Commission rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:


1. The route of the transmission line shall be as shown on Appendix A, and as described in Application No. 1371224 and subsequent applications.
2. Specifications of the transmission line shall include the following:
 - a) The transmission line shall be designed, built for, and operated at a nominal voltage of 240 kV.
 - b) The structures shall be constructed of materials as specified in the application and other previous approvals pertaining to the transmission line.
 - c) Other aspects of the alteration as more particularly described in the application and other previous approvals pertaining to the transmission line.

Permit and Licence No. U2005-468 is rescinded.

¹ Transmission Line Permit and Licence No. U2005-468, Application No. 1436057, December 22, 2005.

² Decision 2011-445: AltaLink Management Ltd. – New 240/138-kV Nilrem 574S Substation, Double-circuit 240-kV Transmission Line 953L/1047L, and Double-circuit 138-kV Transmission Lines 679L/680L, Application No. 1606753, Proceeding ID No. 938, November 10, 2011.

The Commission may cancel or suspend this licence, in whole or in part, in accordance with Section 41 of the *Hydro and Electric Energy Act* or may review this licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with Section 10 of the *Alberta Utilities Commission Act*.

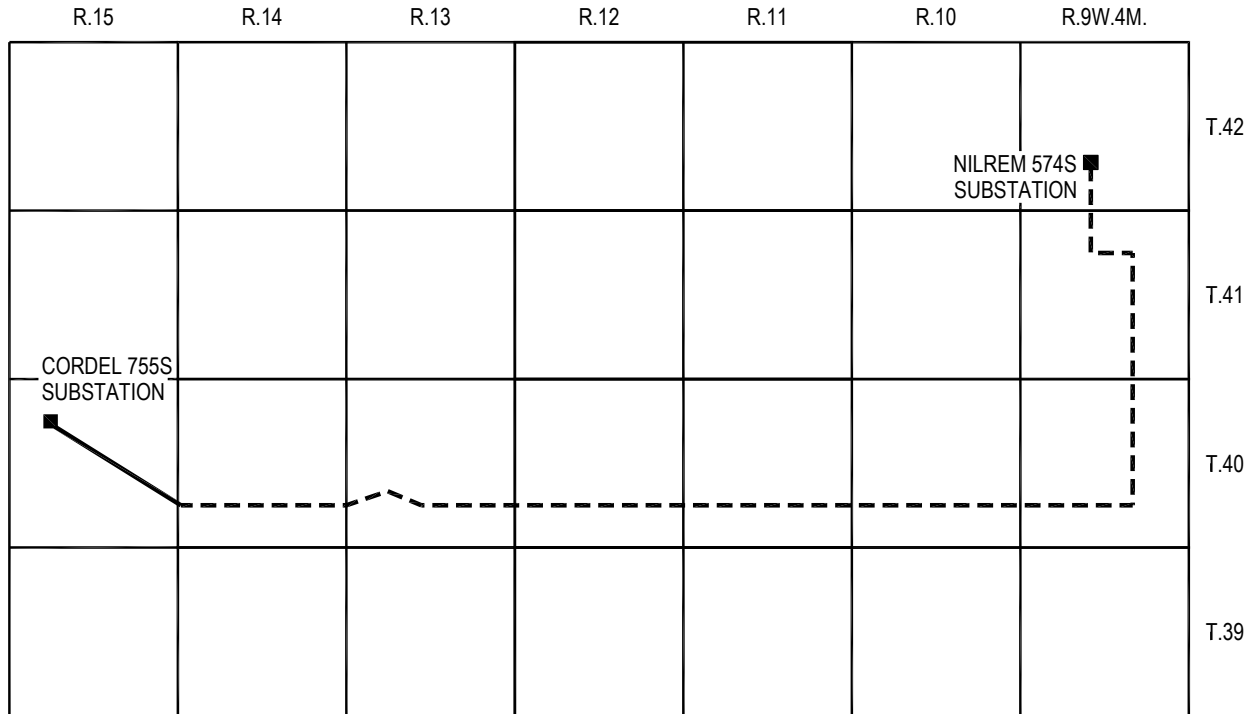

NILREM AREA



APPENDIX A PERMIT AND LICENCE NO. U2011-399

PREVIOUS PERMIT AND LICENCE NO. U2005-468

LEGEND

- ATCO ELECTRIC LTD. 240-kV TRANSMISSION LINE 9L953
- - - ALTALINK MANAGEMENT LTD. 240-kV TRANSMISSION LINE 953L

END OF DOCUMENT