

Transmission Line Permit and Licence 22624-D03-2017

Appendix 2 to Decision 22624-D01-2017	May 18, 2017
ENMAX Power Corporation Alter Transmission Line 138-11.83L	Proceeding 22624 Application 22624-A003

ENMAX Power Corporation (ENMAX), pursuant to Permit and Licence U2010-250,¹ is the operator of the 138-kilovolt (kV) transmission line 138-11.83L from ENMAX No. 11 Substation to ENMAX No. 162 Beddington Substation in the city of Calgary.

ENMAX, by Application 22624-A003, registered on May 2, 2017, applied to the Alberta Utilities Commission for approval to alter and operate the transmission line.

The Commission, pursuant to sections 14, 15 and 19 of the *Hydro and Electric Energy Act*, approved the application in Decision 22624-D01-2017² and granted to ENMAX a permit to alter and a licence to operate the transmission line, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act*, any regulations made under the acts, any orders made under the acts, the Commission rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. The route of the transmission line shall be as shown on Appendix A and as described in the application and previous applications.
2. Specifications of the transmission line shall include the following:
 - a) The northern segment of the transmission line from ENMAX No. 162 Beddington Substation to line structure 138-11.83-22 shall be designated and built for a nominal voltage of 138 kV.
 - b) The southern segment of the transmission line from line structure 138-11.83-22 to ENMAX No. 11 Substation shall be maintained at 240 kV standard.
 - c) The transmission line shall be operated at a nominal voltage of 138 kV.
 - d) The structures shall be constructed of materials as specified in the application and other previous approvals pertaining to the transmission line.
 - e) Other aspects of the alteration as more particularly described in the application and other previous approvals pertaining to the transmission line.

¹ Transmission Line Permit and Licence U2010-250, Proceeding 669, Application 1606261-2, June 18, 2010.

² Decision 22624-D01-2017: ENMAX Power Corporation – ENMAX No. 11 Substation Alteration, Letter of enquiry approval, Proceeding 22624, Applications 22624-A001 to 22624-A003, May 18, 2017.

3. ENMAX shall file with the Commission within 30 days of completing the transmission line alteration, the energization certificate for the transmission line issued by ENMAX, to confirm that the transmission line alteration has been completed and the transmission line is being operated in accordance with the provisions of this permit and licence.
4. Unless otherwise authorized by the Commission, the transmission line alteration shall be completed by May 29, 2018.


Permit and Licence U2010-250 is rescinded.

The Commission may cancel or suspend this permit and licence, in whole or in part, in accordance with Section 41 of the *Hydro and Electric Energy Act* or may review this permit and licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with Section 10 of the *Alberta Utilities Commission Act*.

Alberta Utilities Commission

(original signed by)

Wade Vienneau
Executive Director, Facilities Division
On behalf of the Alberta Utilities Commission

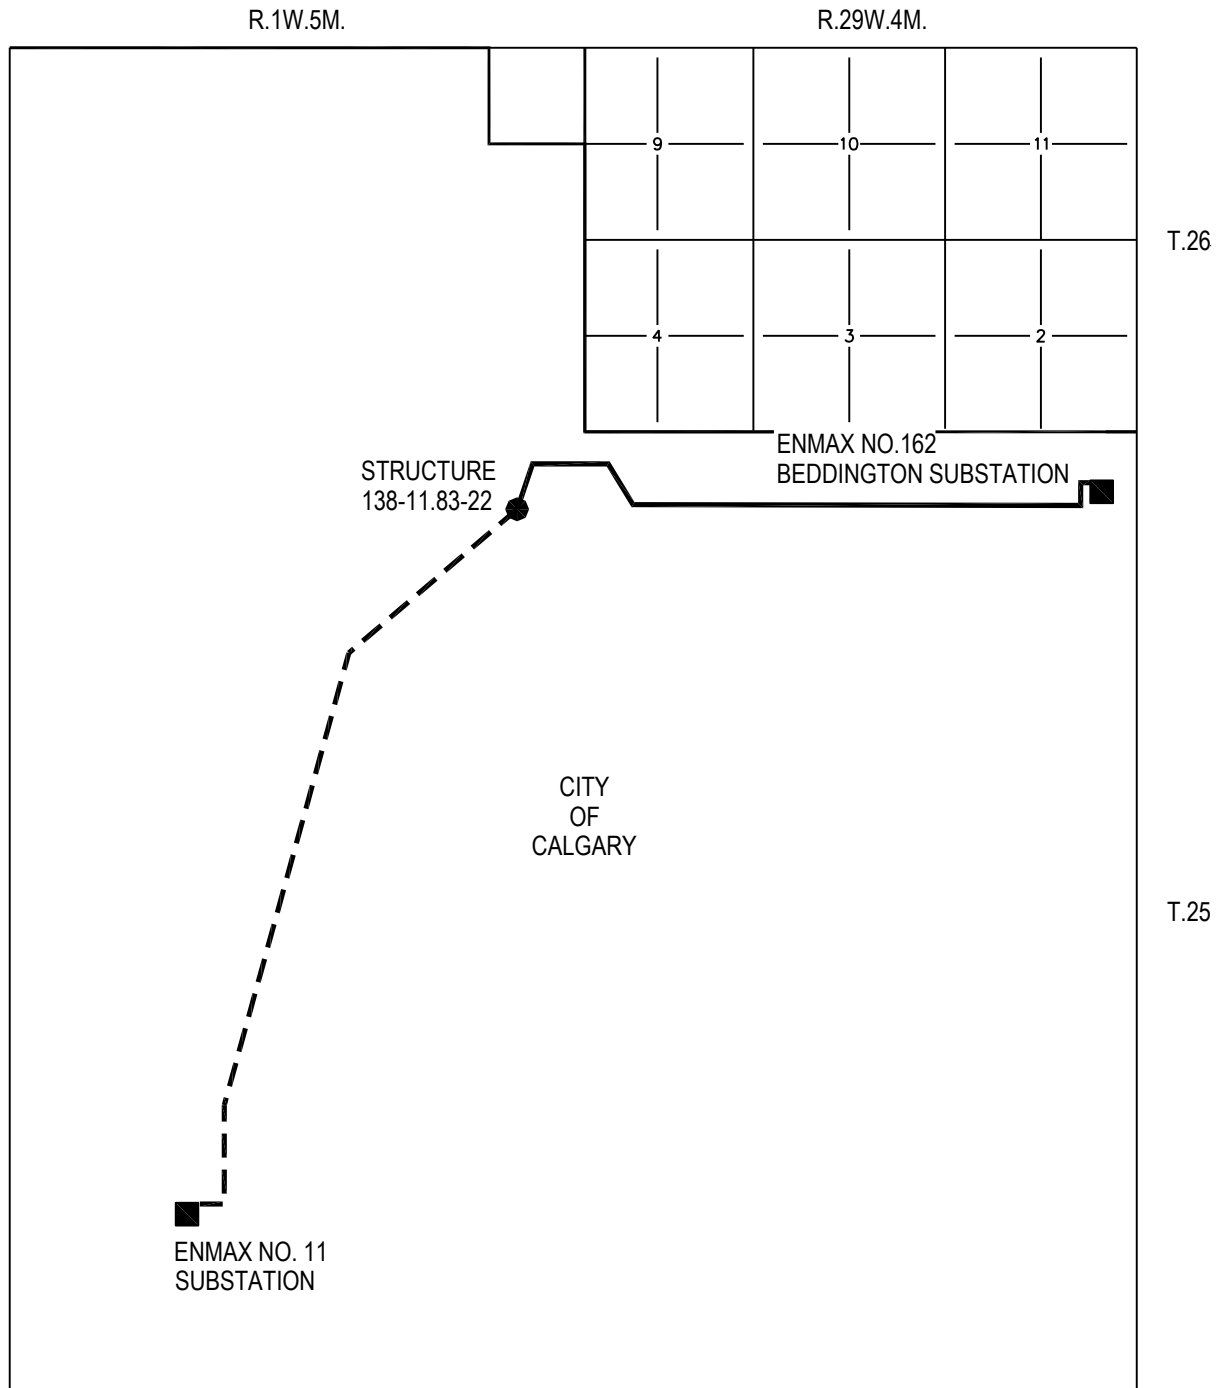

CALGARY AREA

APPENDIX A TO PERMIT AND LICENCE 22624-D03-2017

PREVIOUS PERMIT AND LICENCE U2010-250



LEGEND

- ENMAX POWER CORPORATION 138-kV TRANSMISSION LINE 11.83L
- - ENMAX POWER CORPORATION 138-kV TRANSMISSION LINE 11.83L (built at 240-kV standard)