

## Transmission Line Licence 23128-D10-2018

Appendix 9 to Decision 23128-D01-2018	August 16, 2019
TransAlta Corporation Transmission Line 1139L	Proceeding 23128 Application 23128-A004

TransAlta Corporation, pursuant to Licence 22227-D02-2016,<sup>1</sup> is the operator of the 240-kilovolt (kV) Transmission Line 1139L inside the boundaries of the Stony Plain Indian Reserve 135, west of the city of Edmonton. AltaLink Management Ltd., pursuant to Permit and Licence 20987-D12-2016,<sup>2</sup> is the operator of Transmission Line 1139L from Harry Smith 367S Substation to Petrolia 816S Substation, outside the boundaries of the Stony Plain Indian Reserve 135.

AltaLink, by Application 23128-A004 registered on December 8, 2017, applied to the Alberta Utilities Commission for approval to alter and operate Transmission Line 1139L. AltaLink applied to split Transmission Line 1139L into two separate transmission lines, and rename the portion of the transmission line between Petrolia 816S Substation and Riverview Substation as Transmission Line 1164L. The portion of Transmission Line 1139L between Harry Smith 367S Substation and Riverview Substation would remain as Transmission Line 1139L, including the portion inside the boundaries of the Stony Plain Indian Reserve 135 operated by TransAlta.

The Commission approved the application in Decision 23128-D01-2018<sup>3</sup> and granted AltaLink a permit to alter and a licence to operate Transmission Line 1164L. As a consequence of that decision, the Commission, pursuant to sections 15 and 19 of the *Hydro and Electric Energy Act*, grants to TransAlta a licence to operate Transmission Line 1139L, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act*, any regulations made under the acts, any orders made under the acts, the Commission rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. The route of the transmission line shall be as shown on Appendix A and as described in the application and previous applications.

<sup>1</sup> Transmission Line Licence 22227-D02-2016, Proceeding 22227, Application 22227-A001, December 21, 2016.

<sup>2</sup> Transmission Line Permit and Licence 20897-D12-2016, Proceeding 20987, Application 20987-A010, July 28, 2016.

<sup>3</sup> Decision 23128-D01-2018: Alberta Electric System Operator - Needs Identification Document Application, EPCOR Distribution & Transmission Inc. - Facility Applications and AltaLink Management Ltd. - Interconnection Applications – Riverview Substation Project, Proceeding 23128, Applications 23128-A001 to 23128-A006, September 28, 2018.

2. Specifications of the transmission line shall include the following:
  - (a) The transmission line shall be designed, built for and operated at a nominal voltage of 240 kV.
  - (b) The structures shall be constructed of materials as specified in the application and other previous approvals pertaining to the transmission line.
  - (c) Other aspects of the transmission line as more particularly described in the application and other previous approvals pertaining to the transmission line.

Licence 22227-D02-2016 is rescinded.


The Commission may cancel or suspend this licence, in whole or in part, in accordance with Section 41 of the *Hydro and Electric Energy Act* or may review this licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with Section 10 of the *Alberta Utilities Commission Act*.

The Commission may, within 30 days of the date of this licence and without notice, correct typographical, spelling and calculation errors and other similar types of errors and post the corrected licence on its website.

**Alberta Utilities Commission**

*(original signed by)*

Neil Jamieson  
Commission Member

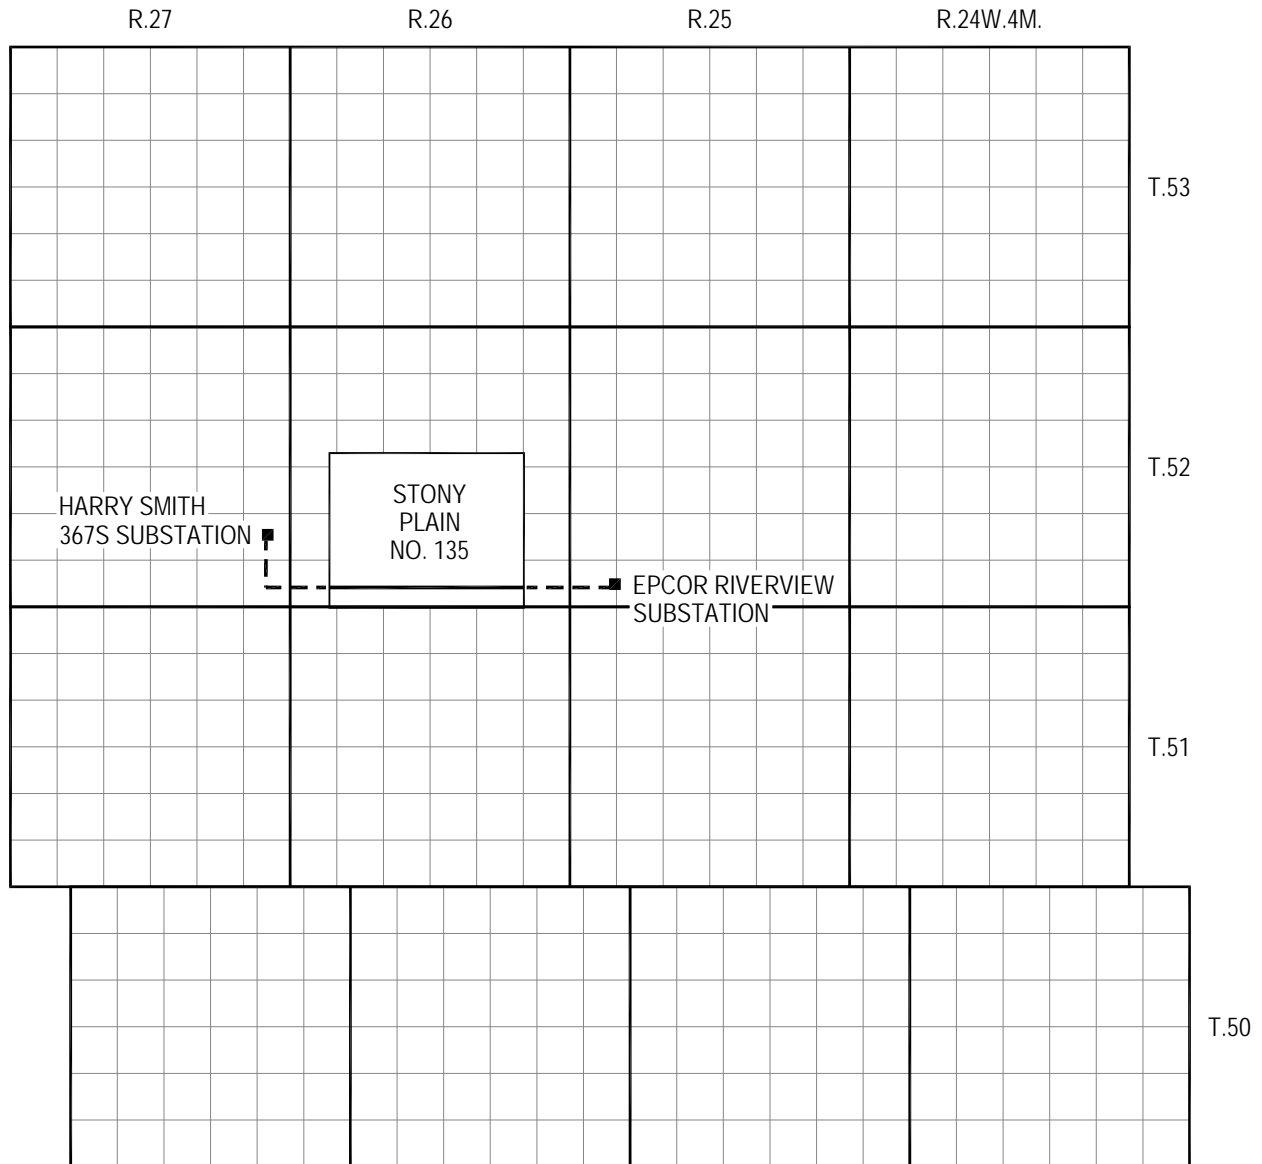



## EDMONTON AREA



APPENDIX A LICENCE 23128-D10-2018

PREVIOUS LICENCE 22227-D02-2016

### LEGEND

-  TRANSALTA CORPORATION 240-KV TRANSMISSION LINE 1139L
-  ALTALINK MANAGEMENT LTD. 240-KV TRANSMISSION LINE 1139L