

## Transmission Line Permit and Licence 24772-D03-2019

Appendix 2 to Decision 24772-D01-2019

August 6, 2019

Suncor Energy Inc.  
Alter Transmission Line 29PL6-04

Proceeding 24772  
Application 24772-A001

Suncor Energy Inc., pursuant to Permit and Licence 23812-D03-2018,<sup>1</sup> has approval to alter and operate the 72-kilovolt (kV) Transmission Line 29PL6-04 from Steepbank River 836S Substation to Millennium Substation 29EDD-1 within its existing industrial system,<sup>2</sup> approximately 25 kilometres north of Fort McMurray.

Suncor, by Application 24772-A001, registered on July 25, 2019, applied to the Alberta Utilities Commission for approval of a time extension to complete alterations to the transmission line.

The Commission, pursuant to sections 14, 15 and 19 of the *Hydro and Electric Energy Act*, approved the application in Decision 24772-D01-2019<sup>3</sup> and granted to Suncor a permit to alter and a licence to operate the transmission line, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act*, any regulations made under the acts, any orders made under the acts, the Commission rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. The route of the transmission line shall be as shown on Appendix A and as described in the application and previous applications.
2. Specifications of the transmission line shall include the following:
  - (a) The transmission line shall be designed, built for and operated at a nominal voltage of 72 kV.
  - (b) The structures shall be constructed of materials as specified in the application and other previous approvals pertaining to the transmission line.
  - (c) Other aspects of the alteration as more particularly described in the application and other previous approvals pertaining to the transmission line.

<sup>1</sup> Transmission Line Permit and Licence 23812-D03-2019, Proceeding 23812, Application 23812-A001, August 27, 2018.

<sup>2</sup> Industrial System Designation Order No. U2013-152, Proceeding 2197, Application 1608922, May 15, 2013.

<sup>3</sup> Decision 24772-D01-2019: Suncor Energy Inc. – Time Extension for Minor Alterations to Transmission Lines 29PL6-03 and 29PL6-04, Proceeding 24772, Application 24772-A001, August 6, 2019.

3. Unless otherwise authorized by the Commission, the transmission line alteration shall be completed by July 31, 2020.

Permit and Licence 23812-D03-2018 is rescinded.

The Commission may cancel or suspend this permit and licence, in whole or in part, in accordance with Section 41 of the *Hydro and Electric Energy Act* or may review this permit and licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with Section 10 of the *Alberta Utilities Commission Act*.


The Commission may, within 30 days of the date of this permit and licence and without notice, correct typographical, spelling and calculation errors and other similar types of errors and post the corrected permit and licence on its website.

### **Alberta Utilities Commission**

*(original signed by)*

Brian Shand, P.Eng.  
Director, Facilities Division  
On behalf of the Alberta Utilities Commission

R.10W.4M.

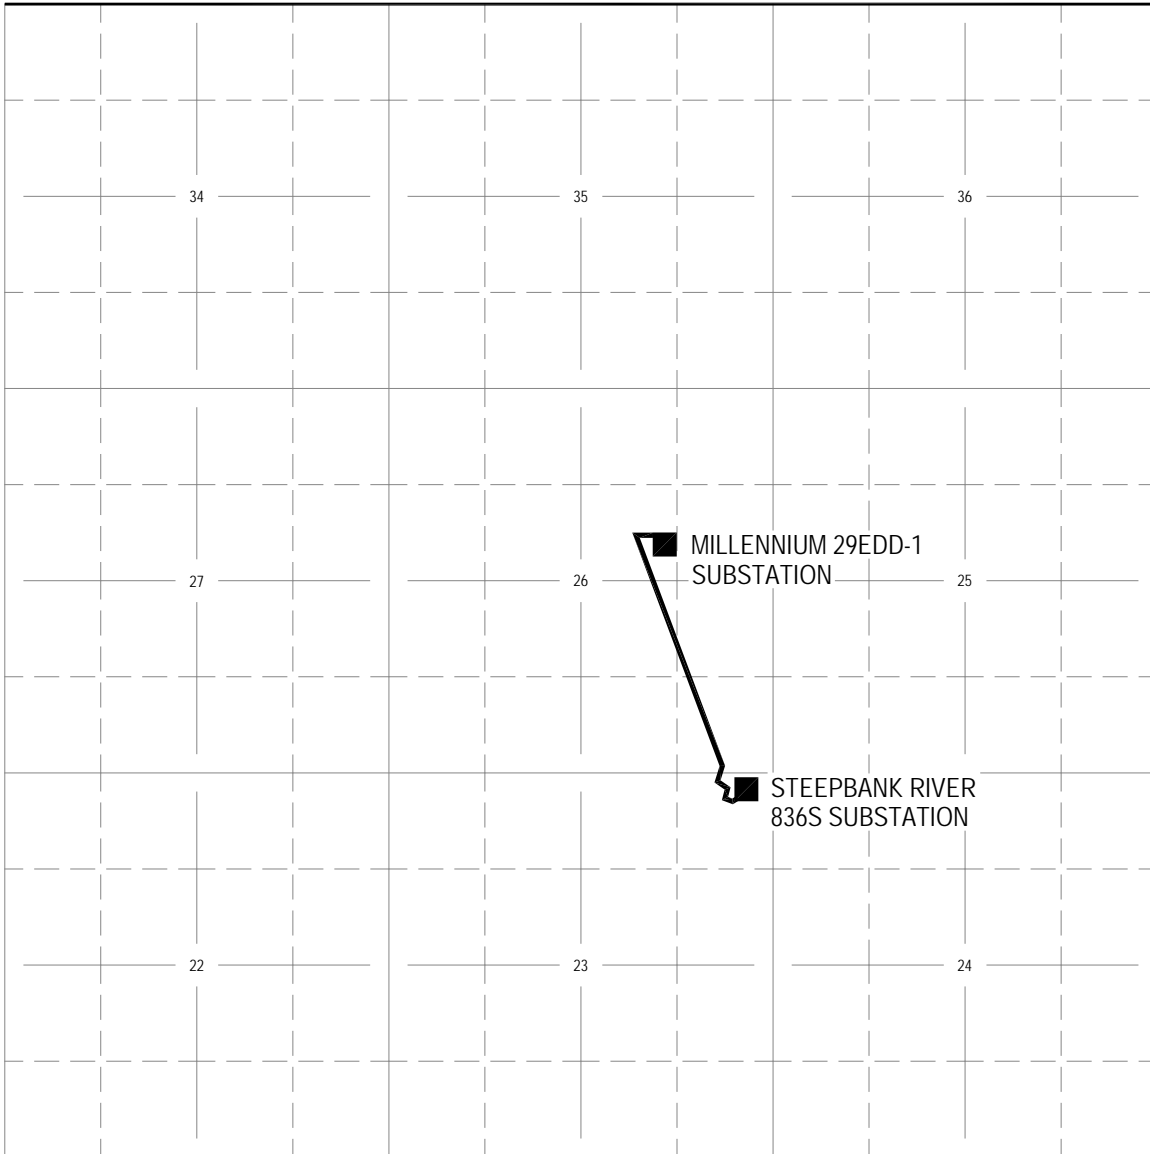

## FORT MCMURRAY AREA

APPENDIX A PERMIT AND LICENCE 24772-D03-2019

PREVIOUS PERMIT AND LICENCE 23812-D03-2018



### LEGEND

— 72-kV TRANSMISSION LINE 29PL6-04